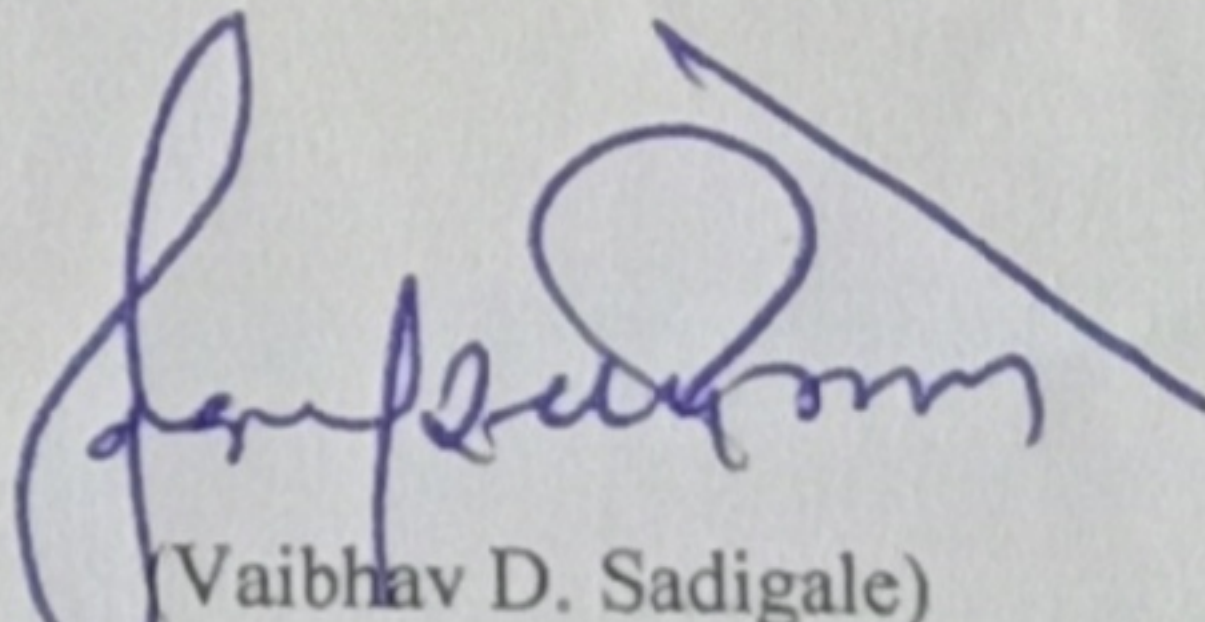


State Public Health Laboratory, Pune					
Cantonment Water Works Compound, Pulgate, Pune 411001. Phone No. 020-26330225					
Report of Bacteriological Examination of Water					
Name & Address of Sender--		Vidya ^{Valley} aniketam /International School, Chakan			
		Dist- Pune			
Letter No.& Date --		05-10-2020			
Laboratory Reference No --		10943			
Date of Collection --		05-10-2020			
Date of Arrival at Laboratory --		05-10-2020			
Date of Commencing Examination--		05-10-2020			
Sr. No.	Particular of Water Samples	Result of Analysis			Remark
		Most Probable Number Per 100 ml.			
		Coliforms	Thermotolerant Coliforms	<i>E. coli</i>	
1	R.O Plant	0	0	0	Potable
Receipt No. /Date & Amount-0707074 /05-10-2020/Rs.-/-340					
Report Outward No & Date 2168 - 08/10/2020					


 (Vaibhav D. Sadigale)
 Chief Bacteriologist,
 State Public Health Laboratory, Pune